

# Design of Double Fed Induction Generator using Fuzzy and PI Controller in Grid Side

G. Ramesh Babu<sup>1</sup>, B. Sivanagaraju<sup>2</sup>

Student, Dept of EEE, GVR&S College of Engineering and Technology, Guntur, India<sup>1</sup>

Assistant Professor, Dept of EEE, GVR&S College of Engineering and Technology, Guntur, India<sup>2</sup>

**Abstract:** The present days wind energy is act as highest role in power industries and also different types of wind technologies are used in power industries depend on the application. Mostly wind based energy generating industries are using double fed induction generator (DFIG) because it is cable to work wide range of speed and frequency. DFIG is a wound rotor induction generator and it improves the electrical energy with rotor and stator plus circuits. Stator sends power directly to grid in unidirectional way. Rotor circuit is connecting to bidirectional converter (AC/DC/AC). The bidirectional converter means power flow in rotor to grid (or) grid to rotor. The main advantage of grid voltage converter is used to maintain constant DC link voltage. In this paper DFIG is controlled by using PI and FUZZY controllers. Finally DFIG is controlled effectively by using FUZZY controller compared to the PI controller with total harmonic distortion analysis (THD). These technologies are design by using software MATLAB/SIMULINK version 2012b.

**Keywords:** Grid Side Converter, DFIG, PI, FUZZY, DC-Link voltage.

## I. INTRODUCTION

Most Of The popular Countries In The World Are generate electrical energy using Renewable Energy Sources, In mostly Wind Energy. Due to its very good characteristics, DFIG is becoming popular wind turbine system, especially for offshore wind farms, [1]-[2].

Doubly Fed Induction Generator (DFIG) is basically a wound rotor induction generator with back-to-back converters between the AC grid and the rotor windings Stator feeds power directly to grid which is unidirectional. Rotor circuit is connected to a bidirectional ac/dc/ac converter having a common dc link bus. Together these three components namely the RSC, the DC-link and the GSC form back-to-back converters. The DC-link thus provides the decoupling between the two AC sides, which are at different frequencies. The GSC controls the DC-link voltage.

A vector control scheme for the grid side converter (GSC) gives an independent control of slip active and reactive power exchanged between the grid and the GSC, in order to ensure sinusoidal supply currents and to maintain DC-link voltage constant.

In this paper, fuzzy logic controller is applied to control the DFIG, a Mamdani type fuzzy logic controller (FLC) is applied to replace the conventional PI controller in the vector control scheme. To show the advantage of this method, a comparative study is conducted between the FLC and the traditional PI controller.

## II. MODELING OF DFIG

The DFIG model adopted in this research paper is the dq0 stationary rotating frame. It is because the model simulation of Doubly Fed Induction Machine (DFIM) is quite suitable with this frame of reference during transients. The transient solution of the DFIM model is possible because of the transformation from abs to dq0 by which the differential equations with time-varying inductances is converted into differential equations with constant inductances, [3]-[4].

The stator circuit equations are given below.

$$V_{qs}^s = R_s i_{qs}^s + \frac{d\psi_{qs}^s}{dt} \quad (1)$$

$$V_{ds}^s = R_s i_{ds}^s + \frac{d\psi_{ds}^s}{dt} \quad (2)$$

Where  $\psi_{qs}^s$  and  $\psi_{ds}^s$  are q-axis and d-axis stator flux linkages, respectively.

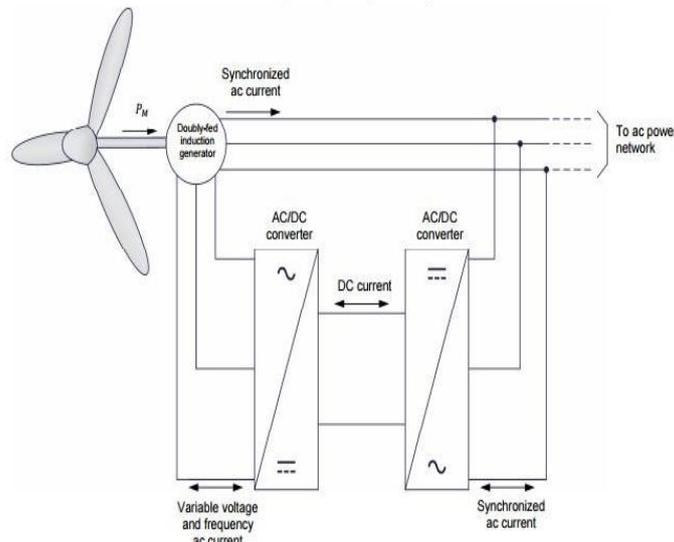


Figure 1 Block Diagram of DFIG

Converting Eq. (1) and Eq. (2) to d-q frame the following equations can be written as:

$$V_{qs} = R_s i_{qs} + \frac{d\psi_{qs}}{dt} + \omega_e \psi_{ds} \quad (3)$$

$$V_{ds} = R_s i_{ds} + \frac{d\psi_{ds}}{dt} - \omega_e \psi_{qs} \quad (4)$$

Owing to the rotor circuit, if the rotor is blocked or not moving, i.e.  $\omega_r = 0$ , the machine equations can be written in similar way as stator equations:

$$V_{qr} = R_r i_{qr} + \frac{d\psi_{qr}}{dt} + \omega_e \psi_{dr} \quad (5)$$

$$V_{dr} = R_r i_{dr} + \frac{d\psi_{dr}}{dt} - \omega_e \psi_{qr} \quad (6)$$

All the parameters are referred to the primary circuit, which is a stator in this case. Let the rotor rotates at an angular speed  $\omega_r$ , then the d-q axes fixed on the rotor fictitiously will move at a relative speed  $\omega_e - \omega_r$  to the synchronously rotating frame, [5].

The d-q frame rotor equations can be written by replacing  $\omega_e - \omega_r$  in place  $\omega_e$  of as follows:

$$V_{qr} = R_r i_{qr} + \frac{d\psi_{qr}}{dt} + (\omega_e - \omega_r) \psi_{dr} \quad (7)$$

$$V_{dr} = R_r i_{dr} + \frac{d\psi_{dr}}{dt} - (\omega_e - \omega_r) \psi_{qr} \quad (8)$$

The flux linkage expressions in terms of current can be written from Fig.3.8 and Fig.3.9 as follows:

$$\psi_{qs} = L_{ls} i_{qs} + L_m (i_{qs} + i_{qr}) = L_s i_{qs} + L_m i_{qr} \quad (9)$$

$$\psi_{ds} = L_{ls} i_{ds} + L_m (i_{ds} + i_{dr}) = L_s i_{ds} + L_m i_{dr} \quad (10)$$

$$\psi_{qr} = L_{lr} i_{qr} + L_m (i_{qs} + i_{qr}) = L_r i_{qr} + L_m i_{qs} \quad (11)$$

$$\psi_{dr} = L_{lr} i_{dr} + L_m (i_{ds} + i_{dr}) = L_r i_{dr} + L_m i_{ds} \quad (12)$$

$$\psi_{qm} = L_m (i_{qs} + i_{qr}) \quad (13)$$

$$\psi_{dm} = L_m (i_{ds} + i_{dr}) \quad (14)$$

Eq. (1) to Eq. (14) describes the complete electrical modeling of DFIG. Whereas the Eq. (15) expresses the relations of mechanical parameters which are essential part of the modeling. The electrical speed  $\omega_r$  cannot be treated as constant in the above equations. It can be connected to the torque as

$$T_e = T_L + J \frac{d\omega_m}{dt} + B\omega_m = T_L + \frac{2}{P} J \frac{d\omega_r}{dt} + \frac{2}{P} B\omega_r \quad (15)$$

### III. GRID SIDE CONVERTER CONTROL

The main aim of the GSC is to maintain the constant DC-link voltage across the common coupling between the back to back converters. To achieve this vector control scheme is used which gives the independent control of active and reactive power flowing between grid and grid side converter. The regulation of the PWM converter is based on the current flowing through it. The direct axis current is used to regulate the DC-link voltage and to regulate the reactive power quadrature axis current is used.

The basic of the vector control is d-q theory or reference frame theory which is used to overcome the problem of time varying parameters with the AC machines, [6].

Essentially by transforming the stator variables to a synchronously rotating reference frame fixed in the rotor. With such transformation (Park's transformation) all the time varying inductances that occur due to an electric circuit in relative motion and electric circuit with varying magnetic reluctances can be eliminated.

Transformation of three phase stationary to two phase stationary axis is given by

$$\begin{bmatrix} V_{qs}^s \\ V_{ds}^s \\ V_{0s}^s \end{bmatrix} = \begin{bmatrix} \cos\theta & \cos(\theta - 120) & \cos(\theta + 120) \\ \sin\theta & \sin(\theta - 120) & \sin(\theta + 120) \\ 0.5 & 0.5 & 0.5 \end{bmatrix} \begin{bmatrix} V_a \\ V_b \\ V_c \end{bmatrix} \quad (16)$$

Transformation of two phase stationary axis to two phase synchronously rotating axis is given by

$$V_{qs} = V_{qs}^s \cos\theta_e - V_{ds}^s \sin\theta_e \quad (17)$$

$$V_{ds} = V_{qs}^s \sin\theta_e + V_{ds}^s \cos\theta_e \quad (18)$$

The GSC voltages in its d-q components are obtained by the typical configuration of control strategy is given by

$$V_q = R i_q + L \frac{di_q}{dt} + \omega_e L i_d + v_{q1} \quad (19)$$

$$V_d = R i_d + L \frac{di_d}{dt} - \omega_e L i_q + v_{d1} \quad (20)$$

Applying the Laplace transforms to the above two equations

$$V_q = (R + sL) i_q + \omega_e L i_d + v_{q1} \quad (21)$$

$$V_d = (R + sL) i_d - \omega_e L i_q + v_{d1} \quad (22)$$

Considering

$$V_q' = (R + sL) i_q \quad (23)$$

$$V_d' = (R + sL) i_d \quad (24)$$

The angular position of the supply voltage is calculated as

$$\theta_e = \int \omega_e dt = \tan^{-1} \frac{v_\beta}{v_\alpha} \quad (25)$$

Where  $v_\alpha$  and  $v_\beta$  are the,  $\beta$  (stationary 2-axis) stator voltage components.

The control scheme thus utilizes current control loops for  $i_d$  and  $i_q$ , with the  $i_d$  demand being derived from the DC-link voltage error through a standard PI controller. The  $i_q$  demand determines the displacement factor on the supply side of the inductor. The plant for the current control loops is given by:

$$F(S) = \frac{i_q}{v_q'} = \frac{i_d}{v_d'} = \frac{1}{R + sL} \quad (26)$$

Substituting (23),(24) in (21),(22) respectively, and being  $V_q(s) = 0$  the reference for the voltages values  $V_{q\_ref}$  and  $V_{d\_ref}$  can be obtained by:

$$V_{q\_ref} = -v'_q - \omega_e Li_d + v_q$$

$$V_{d\_ref} = -v'_d + \omega_e Li_q + v_d$$

The value of  $V_{q\_ref}$  and  $V_{d\_ref}$  are considered to be the reference input values to the PWM converter by which level of DC voltage and required power factor is achieved.

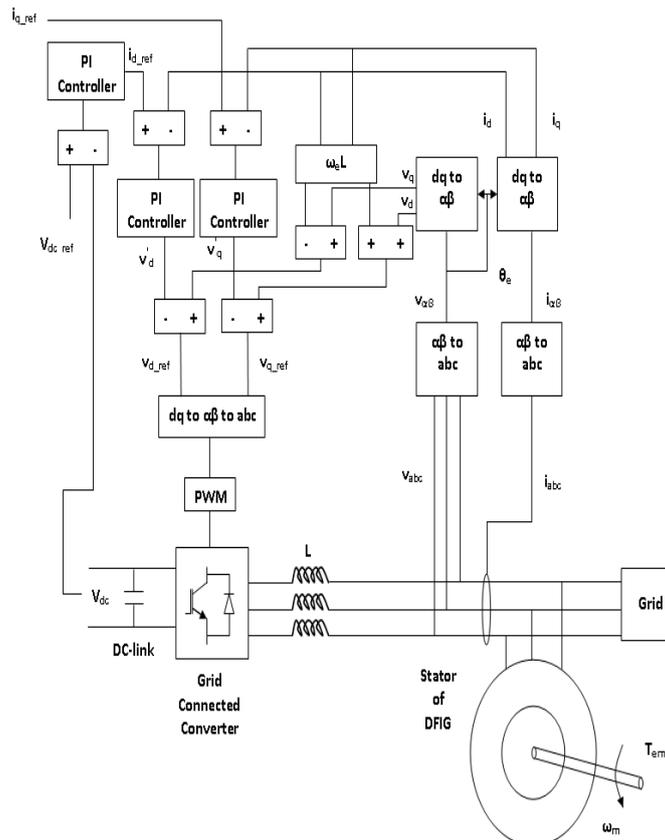


Figure 2 Grid side converter control strategy

#### IV. PI CONTROLLER BASED DFIG

Proportional Integral controller based technique is the traditional method used to regulate the DC –link voltage. These control techniques are used to achieve better dynamic control of DFIG. This control technique having the advantages of [6]

1. Constant DC-link voltage in case of a wind park or wind turbine.
2. When wind speed is very high restricted generation of active power is allowed.
3. Maintenance cost is minimized and also exploration in case of wind park or wind turbine.

#### V. DESIGN OF FUZZY CONTROLLER

Proportional integral control technique is commonly using traditional control technique but the performance of the PI controller is mainly based on a suitable choice of the PI gains. Tuning of PI gains becomes the most difficult task. To overcome this problem a robust controller is needed. Fuzzy is one of these control technique which is robust about to many non linear procedures, [7].

Fuzzy controller uses a systematic method to control a nonlinear procedure based on human experience. This is defined as heuristic method this can enhance the operation of closed loop system. The operation of the fuzzy controller is based on its capability to simulate several role implications at the same time procedure, and it results the significantly comprehensive output.

A well designed fuzzy controller can provide enhanced operation in presence of variations in parameters, external perturbations, and load existence than conventional PI controllers. The design of fuzzy controller mainly consists of four building blocks: fuzzification block, fuzzy knowledge based block, fuzzy inference engine and defuzzification block. The conversion of the classical set to the fuzzy set is called the fuzzification. Triangular fuzzifier is used among different fuzzifiers such as triangular, trapezoidal, singleton and Gaussian. By assigning some membership function to each and every input with the help of the fuzzifier is convert input into fuzzy set, [8]-[9].

A graph between input and membership value which varies from 0 to 1 is called the membership function. it provides impreciseness to the fuzzy logic. Triangular membership function is used among the different membership functions such as trapezoidal, Gaussian, sigmoid, piecewise linear.

Fuzzy inference engine consists of knowledge base, in which the rules are framed. it can be broadly categorized into two types

1. Mamdani method
2. sugeno method

Sugeno method is generally based on mathematical analysis and calculations. But in mamdani method linguistic logic used to make the rules which is very simple compared to the sugeno method. Mamdani method is computationally efficient when compared to the sugeno method

Table 1.The Fuzzy rule base

e Δe	NL	NM	NS	EZ	PS	PM	PL
NL	NL	NL	NL	NL	NM	NS	NL
NM	NL	NL	NL	NM	NS	EZ	NM
NS	NL	NL	NM	NS	EZ	PS	NS
EZ	NL	NM	NS	EZ	PS	PM	EZ
PS	NM	NS	EZ	PS	PM	PL	PS
PM	NS	EZ	PS	PM	PL	PL	PM
PL	EZ	PS	PM	PL	PL	PL	PL

The fuzzy sets have been determined as: NL, negative large, NM, negative medium, NS, negative small and ZE, zero, PS, Positive small, PM, positive medium, PL, positive large, respectively

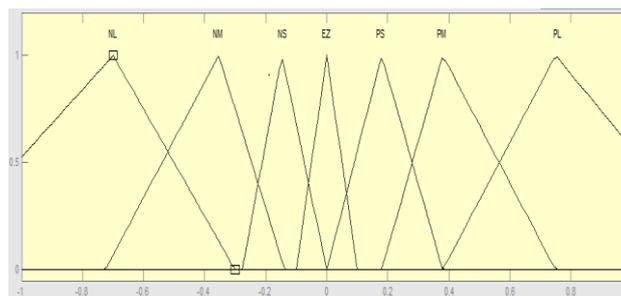


Figure 3 Triangular membership functions for input, change in error and output fuzzy sets of the fuzzy controller.

## VI. SIMULATION DIAGRAMS

A wind power generation system based on doubly fed induction generator (DFIG) connected to grid system with PI and Fuzzy control system is simulated using MATLAB\SIMULINK software. The frequency is set to 50Hz. The DC link voltage is regulated at 1200V. Figure 4 shows the simulation of DFIG in which stator is connected to the grid and rotor connected to the grid by the back to back PWM converters.

## VII. SIMULATION RESULTS

The GSC control strategy using PI and Fuzzy logic is implemented for DFIG using MATLAB/Simulink and results are presented in this section. The performance of the PI and Fuzzy logic controllers is analyzed by using FFT analysis. The main objective of the GSC is to main DC-Link voltage constant. The reference voltage to the DC-Link is taken as 1200V. The DC-link voltage using PI and Fuzzy logic controller are shown in figures.

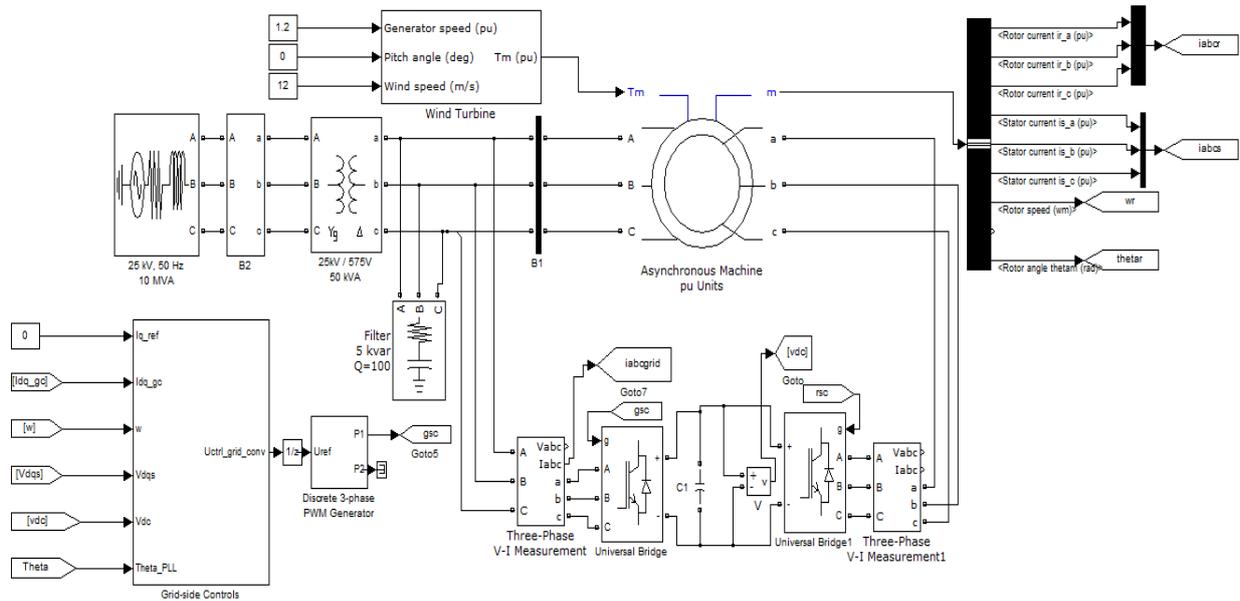


Figure 4 Simulation of diagram of DFIG system.

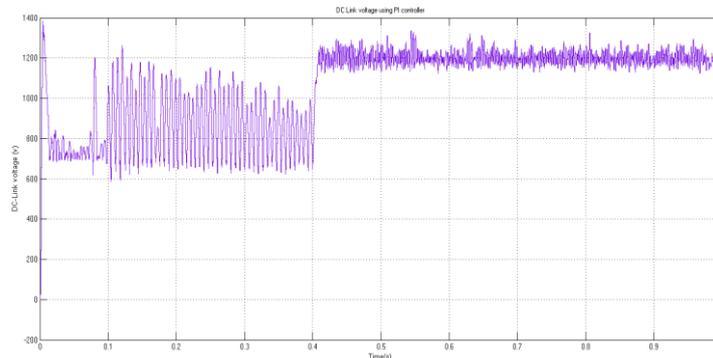


Figure 5 DC-Link voltages across capacitor using PI controller

Figure 5 shows the DC-Link voltage using PI controller. In the waveform voltage matches to the reference voltage that is 1200V. Settling time is less than 0.1 sec. But analysing the waveform it contains more ripple content which disturbs the performance. From figure 6 DC-Link voltage using fuzzy controller is analysed. Fuzzy logic controllers enhance the performance and profile of the DC-Link voltage and also ripple content is reduced.

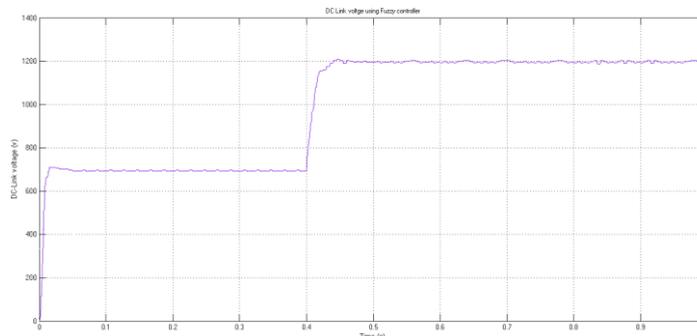


Figure 6- DC-Link voltage using Fuzzy controller

Performance of grid currents using PI controller is shown in figure7 which gives the sluggish response and also having the THD value of 38.52% shown in figure 8 by the FFT analysis these grid currents cause the system to be unstable. So there is a need of improved performance which is achieved by the fuzzy logic controller. By using fuzzy logic controller 3 phase grid currents waveform is improved as shown in figure 9 and also ripple content of the waveform is decreased drastically. The THD value decreased to 2.36% as shown in figure 10.

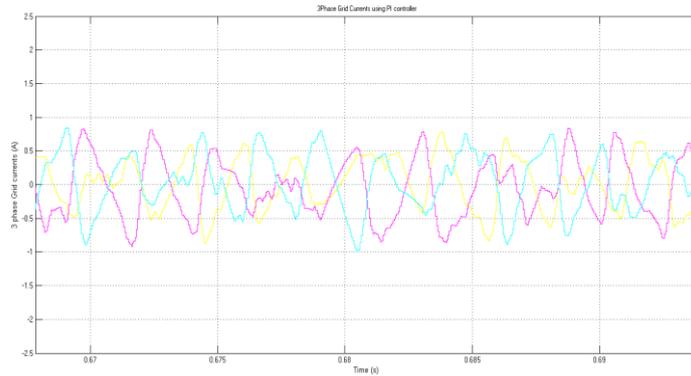


Figure 7- 3 Phase Grid currents using PI controller

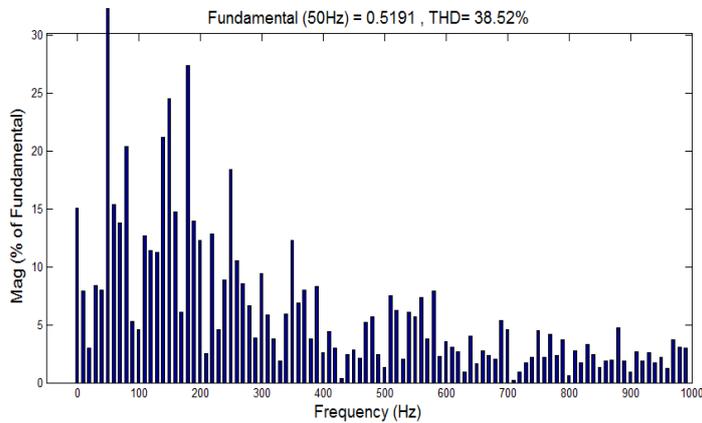


Figure 8 FFT Analysis of Grid currents using PI controller

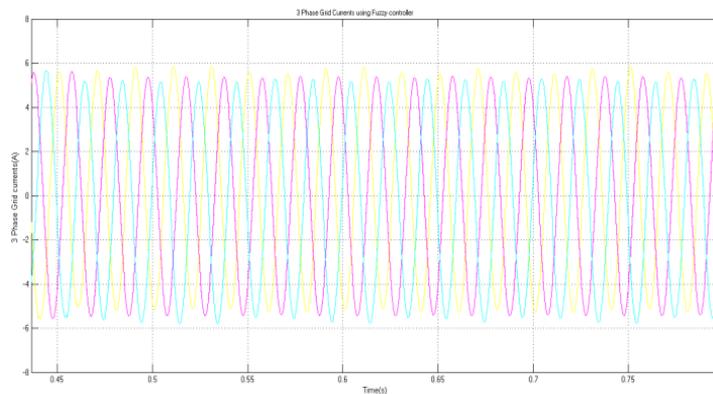


Figure 9- 3Phase Grid currents using Fuzzy logic controller

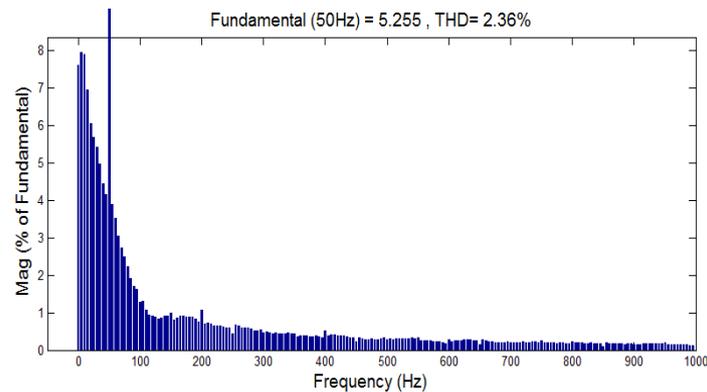


Figure 10 FFT Analysis of Grid currents using Fuzzy controller



### VIII. CONCLUSION

This paper PI and FUZZY applied to grid side control of DFIG effectively. The simulation results of FUZZY controller in grid side control DFIG give a better result compared to PI controller with total harmonic distortion analysis. So finally FUZZY controller was highly efficient control technique in grid side control DFIG. This reason we justify FUZZY controller have very high robustness compared to PI controller.

### REFERENCES

- [1] J. F. Walker, N. Jenkins, "Wind Energy Technology", John Wiley & Sons, Ltd, 1997.
- [2] T. Ackermann, "Wind Power in Power Systems", John Wiley & Sons, Ltd, England, 2005
- [3] A. Tapia, G. Tapia, J. X. Ostolaza, J. R. Saenz, R. Criado, J. L. Berasategui, "Reactive power control of a wind farm made up with doubly fed induction generators", (I) and (II), IEEE PortoPower Tech Conference, 2001.
- [4] J. L. Rodríguez-Amenedo, S. Arnalte, J. C. Burgos, "Automatic generation control of a wind farm with variable speed wind turbines", IEEE Transactions on Energy Conversion, vol. 17, no 2, pp. 279-284, 2002.
- [5] Satish Choudhury, Kanungo Barada Mohanty, B.Chitti Babu, —Performance Analysis of Doubly-Fed Induction Generator for Wind Energy Conversion System, Proc. PSU- UNS International Conference on Engineering and Technology (ICET-2011), Phuket, Thailand, pp.532-536, May 2011.
- [6] R. Pena, J. C. Clare, G. M. Asher, "Doubly fed induction generator using back-to-back PWM converters and its application to variable-speed wind-energy generation", IEE Proc.-Elect. Power Appl., vol. 143, no 3, May 1996.
- [7] Xu L, Wang Y. "Dynamic modeling and control of DFIG-based wind turbines under unbalanced network conditions" (J). IEEE Transactions on Power Systems, 22(I): 314-323. 2007.
- [8] J Hee-Sang Ko, Gi-Gab Yoon and Nam-Ho Kyung (2009) "Variable speed DFIG wind energy system for power generation and harmonic current mitigation" Renewable Energy 34 1545–1553.
- [9] Jingjing Zhao, Xin Li ,JutaoHao and Jiping Lu (2010) "Reactive power control of wind farm made up with doubly fed induction generators in distribution system" Electric Power Systems Research 80 698–706.
- [10] S. Muller, M. Deicke and Rik W. De Doncker, "Doubly fed induction generator systems for wind turbines", IEEE Industry Applications Magazine, Vol. 8, No.3, pp. 26-33, May/June 2002.
- [11] G.B. Chung and J.H Choi, "Application of fuzzy PI control algorithm as stator power controller of double – fed induction machine in wind power generation systems," J. Power Electron., vol 9, no. 5, pp. 677 – 685, Sep. 2009.
- [12] Yazhou Lei; Mullane, A.; Lightbody, G.; Yacamini, R., "Modeling of the wind turbine with a doubly fed induction generator for grid integration studies," Energy Conversion, IEEE Transactions on, vol.21, no.1, pp.257 – 264, March 2006.